

VARSLINGSTYPER FOR DRONECENTER

ALERT SYSTEMS FOR THE DRONE CENTER


Dronecenteret indeholder ingen brandtekniske installationer i form af hverken automatisk varsling, sprinkling eller røgdetektering. Derfor foregår evakuering af bygningen ved hjælp af mundtligt anrøb.

Mvh, Teknisk Service, SDU

There are no fire protection and safety installations such as automatic alarm system, sprinklers or smoke detectors at the Drone Center. Therefore, evacuation of the building must be done by orally informing others in the building that a critical situation has occurred.

Best regards, Technical Services, SDU

PLAN 0 / LEVEL 0

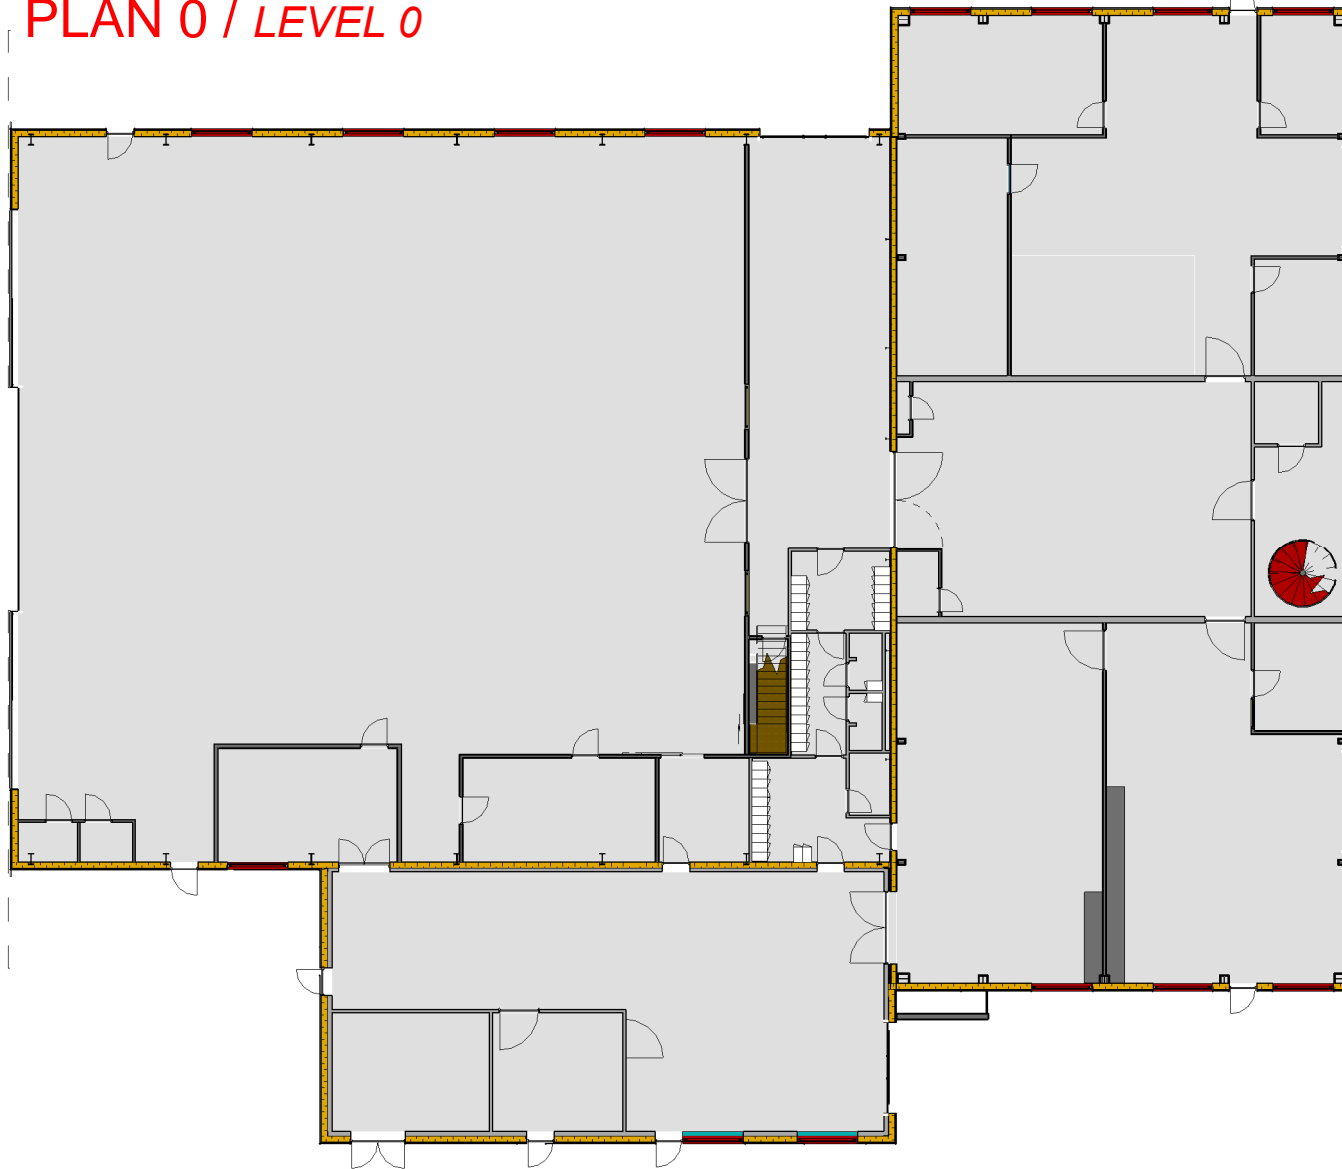

PLAN 1 / LEVEL 0

